




# SOUND ABSORPTION COEFFICIENT

Measured and evaluated according to ISO 354 and ISO 11654

**Client:** Blå Station

**Surface:** Ginkgo

Octave band (Hz)	Sound absorption coefficient (-)
63	0.05
125	0.15
250	0.6
500	0.9
1000	0.8
2000	0.75
4000	0.7
$\alpha_w$	0.80
NRC	0.75

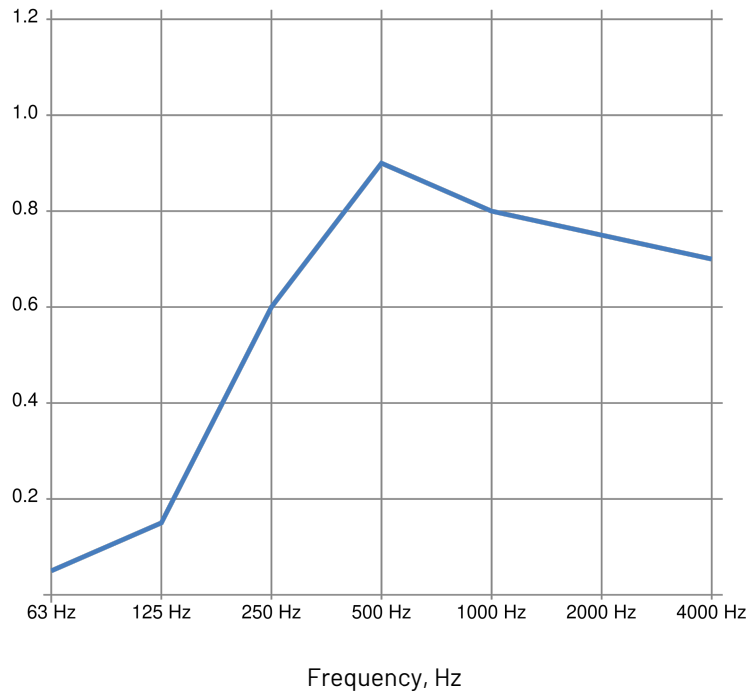

ORIGINAL TEST REPORT

14-117-M2

DATE OF REPORT

2014-08-26

