




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|-------------|---------|--------|
| Client: | Abstracta | | |
| Object: | Soneo Table | | |
| Size [mm]: | w = 1000 | h = 650 | d = 30 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|------------------------------|---|
| 63 | 0.21 |
| 125 | 0.27 |
| 250 | 0.49 |
| 500 | 0.69 |
| 1000 | 0.8 |
| 2000 | 0.88 |
| 4000 | 0.95 |
| N₁₀ = 14.5 | |

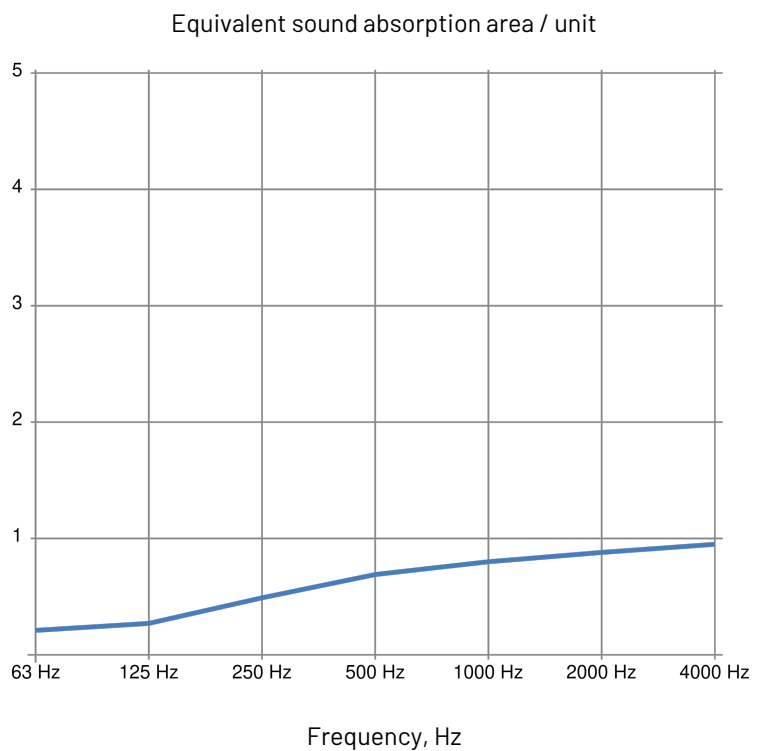

| | |
|--|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverkstan report 15-065-M2 (preliminary) | 2015-04-10 |

