




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	dB Pillar 1930		
<b>Size [mm]:</b>	w = 1930	h = 470	d = 369

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	1.13
125	3.04
250	2.44
500	2.23
1000	2
2000	2.05
4000	2.23
<b>N<sub>10</sub> = 5</b>	

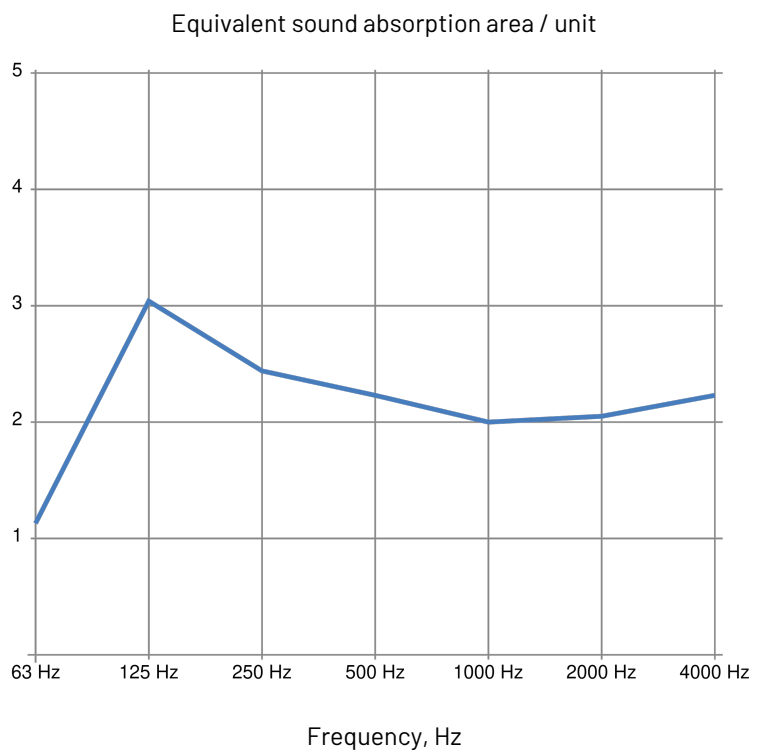

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
KTH-MWL ABSTRACTA 20200107 Object A13	2020-01-10

