




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Mount Design		
Object:	HILO Flexwall		
Size [mm]:	w = 1220	h = 1190	d = 1670

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	1.3
125	1.7
250	2.3
500	3.1
1000	4.6
2000	5.9
4000	7.4
N₁₀ = 3.2	

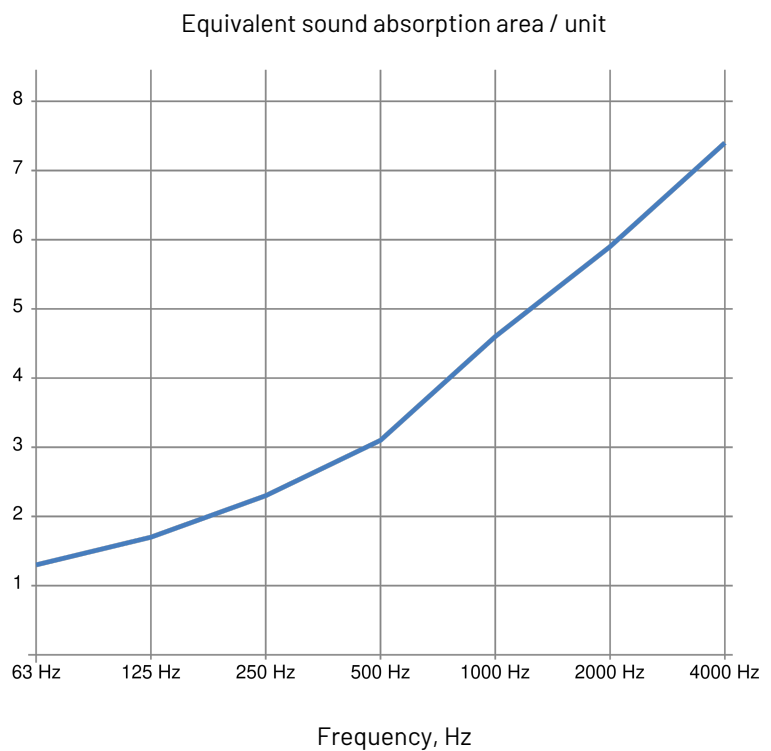

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 20-720-M1	2020-06-23

