




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Mount Design		
Object:	HILO Flexwall		
Size [mm]:	w = 1420	h = 1190	d = 1670

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	1.3
125	1.8
250	2.4
500	3.3
1000	4.9
2000	6.4
4000	7.9
N₁₀ = 3	

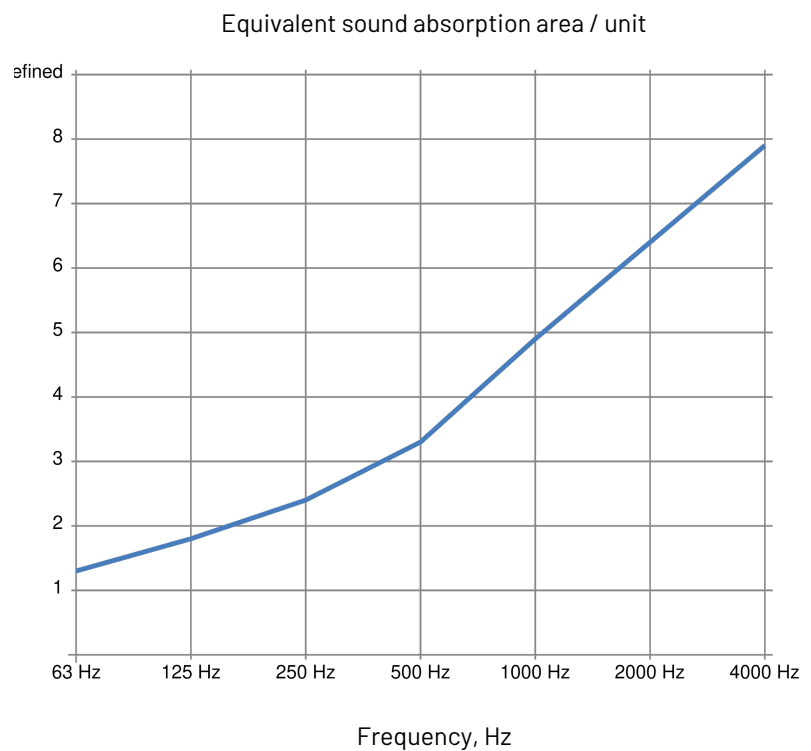

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 20-720-M4	2020-06-23

