




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Mount Design		
<b>Object:</b>	HILO FloorScreen		
<b>Size [mm]:</b>	w = 1800	h = 1200	d = 43

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.3
125	0.6
250	1.5
500	2.7
1000	3.4
2000	3.5
4000	4.1
<b>N<sub>10</sub> = 3.7</b>	

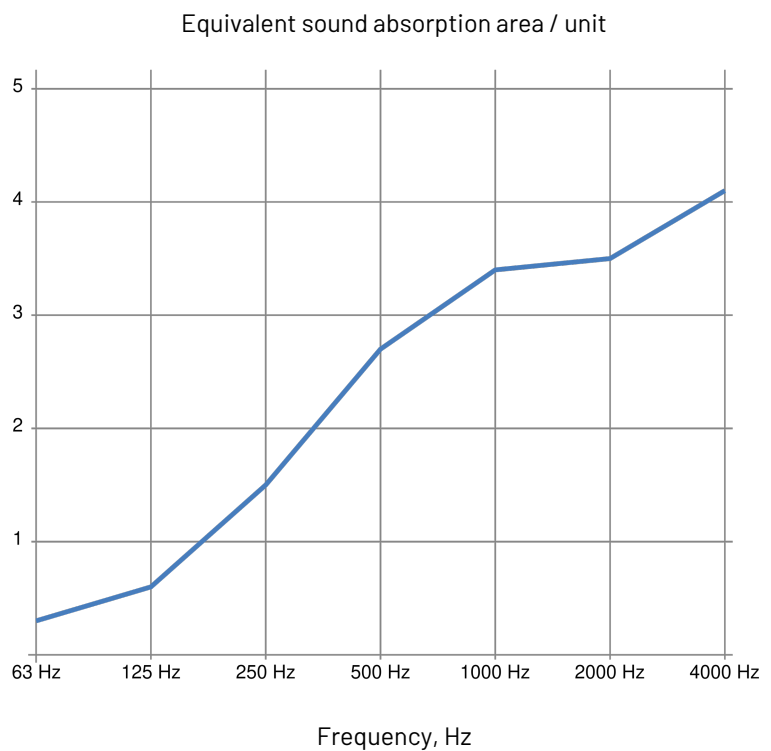

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 20-720-M3	2020-06-23

