




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	Domo Wall A4		
<b>Size [mm]:</b>	w = 600	h = 1200	d = 34

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0
125	0.1
250	0.2
500	0.4
1000	0.6
2000	0.6
4000	0.5
N <sub>10</sub> = 25	

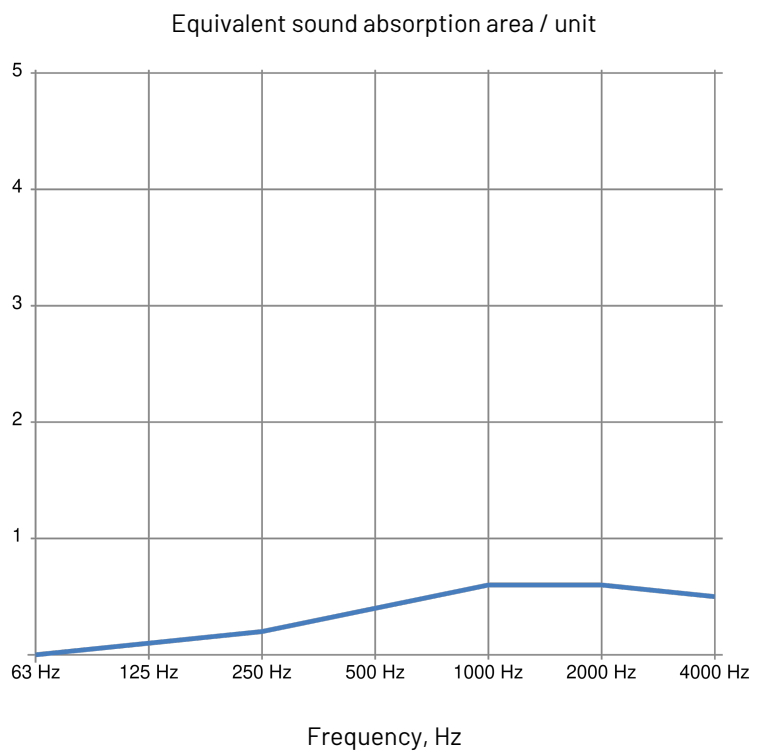

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF TEST</b>
Akustikverkstan report 14-125-M8	2014-09-24

