




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Domo Wall A4		
Size [mm]:	w = 600	h = 1200	d = 34

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0
125	0.1
250	0.2
500	0.4
1000	0.6
2000	0.6
4000	0.5
N ₁₀ = 25	

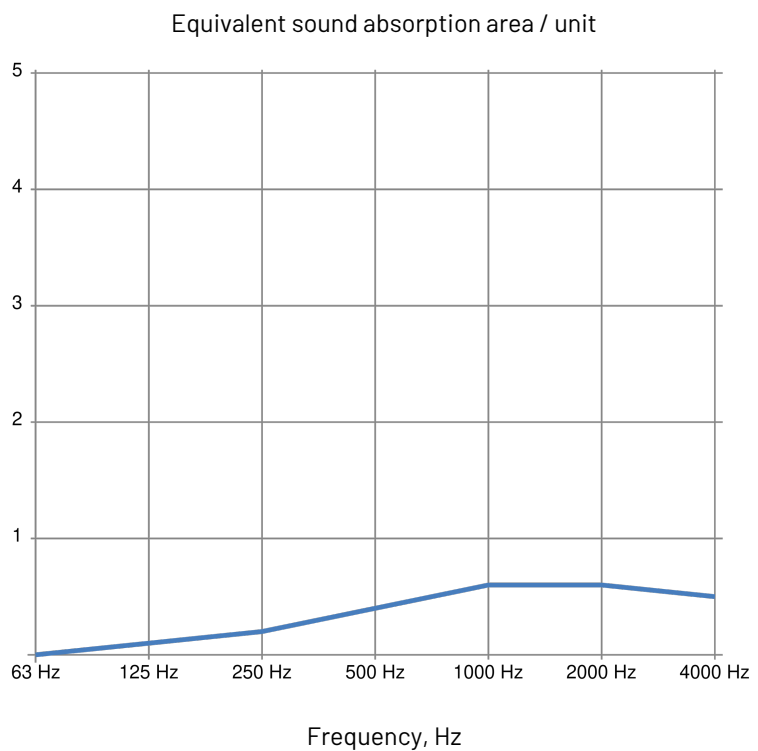

ORIGINAL TEST REPORT	DATE OF TEST
Akustikverkstan report 14-125-M8	2014-09-24

