




SOUND ABSORPTION COEFFICIENT

Measured and evaluated according to ISO 354 and ISO 11654

| | |
|---------------------------|-------------------------|
| Client: | Parafon |
| Surface: | Parafon® Step for Grids |
| Suspension Height: | w = 100 |

| Octave band (Hz) | Sound absorption coefficient (-) |
|------------------|----------------------------------|
| 63 | 0.05 |
| 125 | 0.25 |
| 250 | 0.7 |
| 500 | 1 |
| 1000 | 1 |
| 2000 | 1 |
| 4000 | 1 |
| α_w | 1.00 |
| NRC | 0.95 |

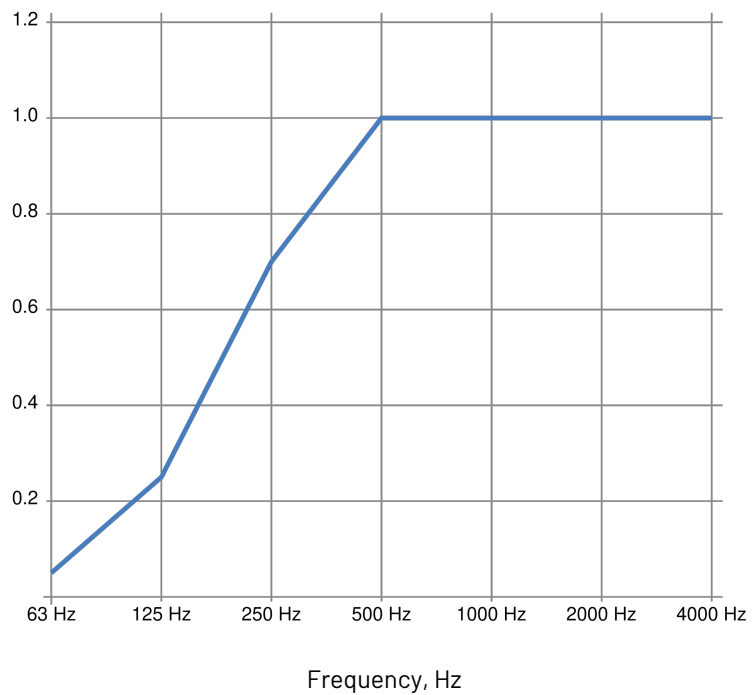

| | |
|-----------------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverkstan report 17-322-M18 | 2017-12-15 |

