




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Kinnarps		
Object:	Prim Floor Screen 80x198		
Size [mm]:	w = 800	h = 1980	d = 55

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.2
125	0.6
250	1.5
500	2.3
1000	2.8
2000	2.9
4000	2.9
N₁₀ = 4.3	

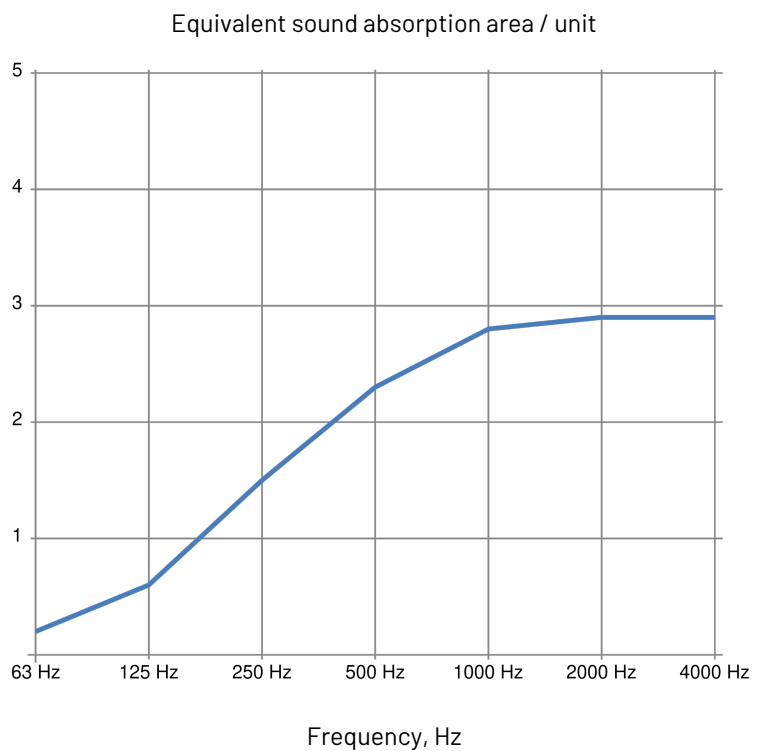

ORIGINAL TEST REPORT	DATE OF TEST
SP report 4P03869	2014-06-19

