




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Hertz Floor		
Size [mm]:	w = 800	h = 1200	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.24
125	0.38
250	0.79
500	1.3
1000	1.8
2000	1.8
4000	1.8
N₁₀ = 7.7	

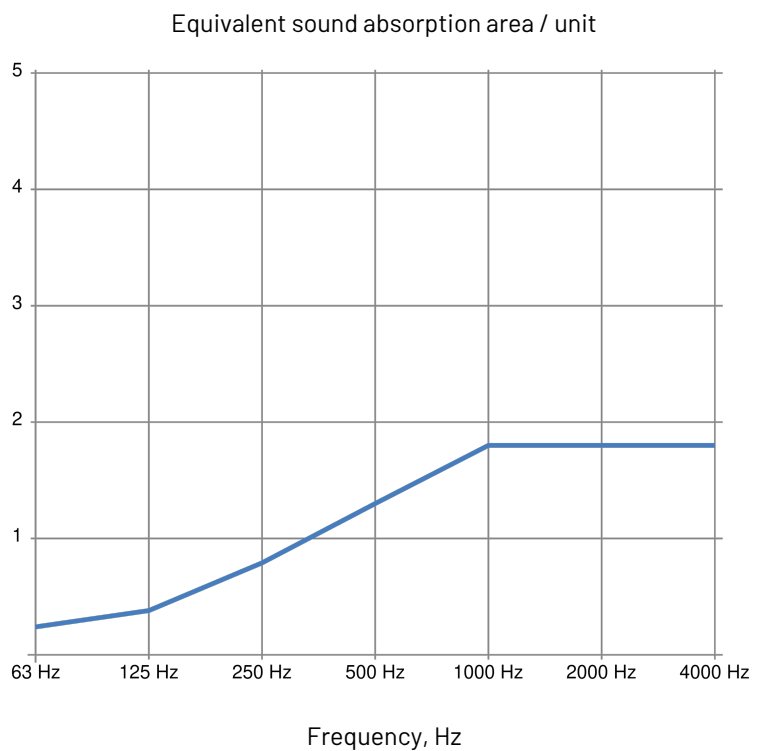

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M10	2021-10-29

