




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Decibel AB		
<b>Object:</b>	Hertz Floor		
<b>Size [mm]:</b>	w = 800	h = 1800	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.36
125	0.57
250	1.3
500	2.1
1000	2.8
2000	2.7
4000	2.7
<b>N<sub>10</sub> = 4.8</b>	

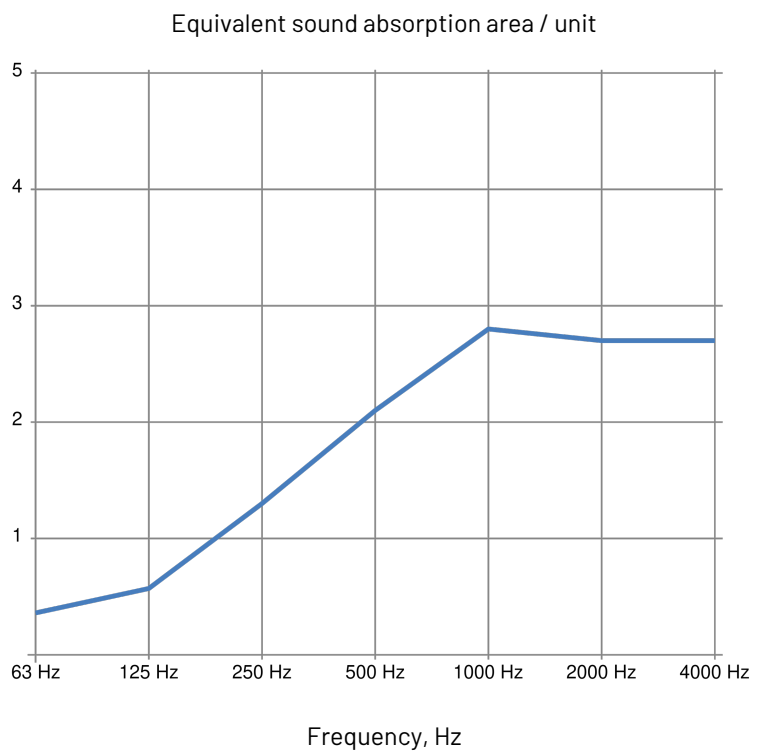

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 21-738-M11	2021-10-29

