




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Decibel AB		
<b>Object:</b>	Hertz Floor		
<b>Size [mm]:</b>	w = 1000	h = 1200	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.23
125	0.47
250	0.97
500	1.7
1000	2.2
2000	2.1
4000	2.2
<b>N<sub>10</sub> = 5.9</b>	

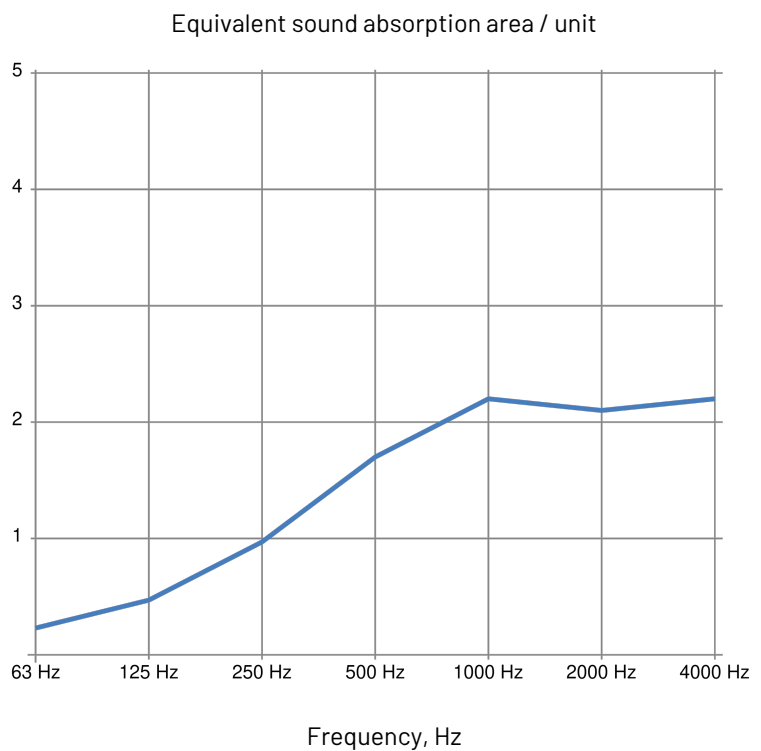

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 21-738-M12	2021-10-29

