




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Hertz Floor		
Size [mm]:	w = 1000	h = 1200	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.23
125	0.47
250	0.97
500	1.7
1000	2.2
2000	2.1
4000	2.2
N₁₀ = 5.9	

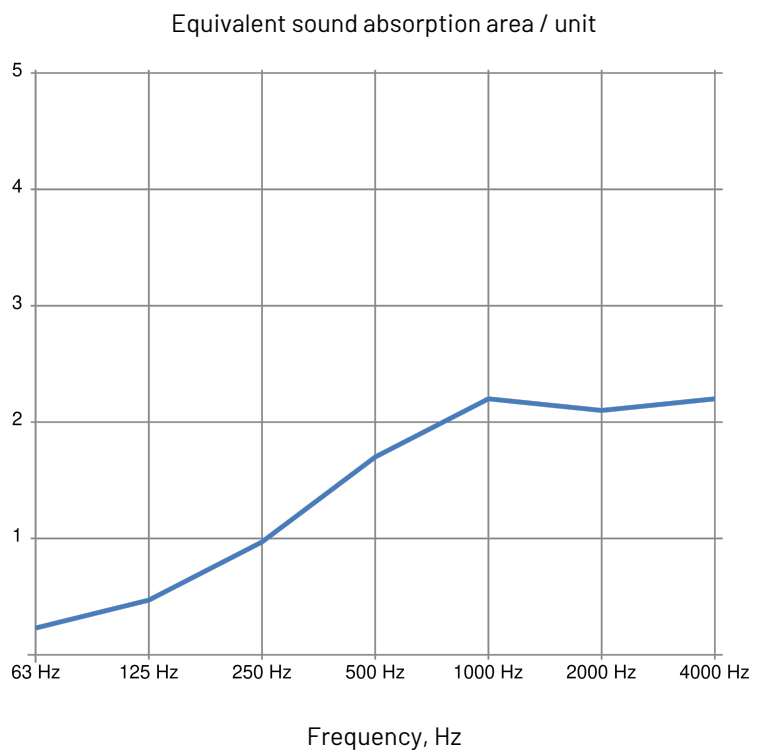

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M12	2021-10-29

