




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Decibel AB		
<b>Object:</b>	Hertz Floor		
<b>Size [mm]:</b>	w = 1000	h = 1800	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.48
125	0.76
250	1.5
500	2.4
1000	3.3
2000	3.2
4000	3.4
<b>N<sub>10</sub> = 4.2</b>	

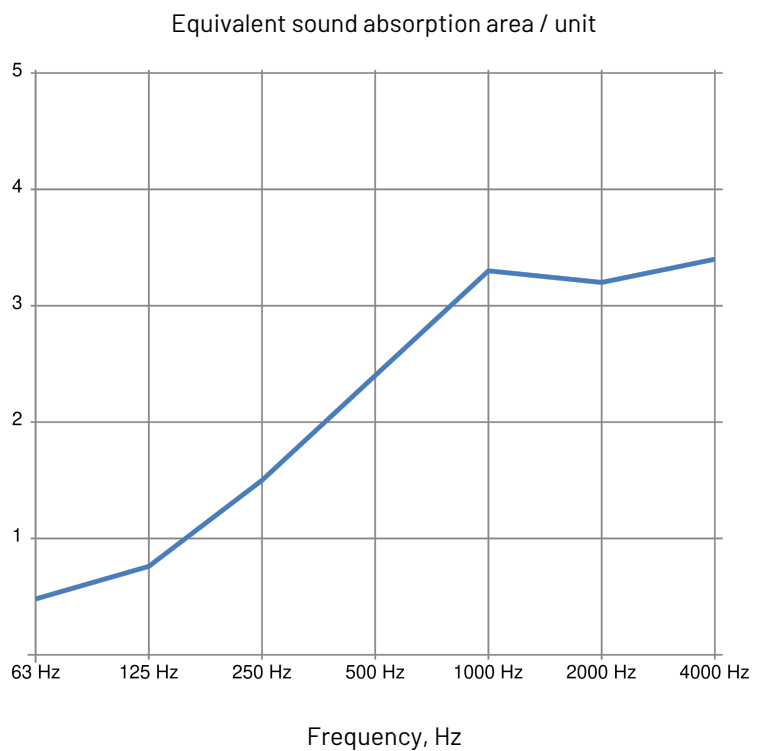

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 21-738-M13	2021-10-29

