




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Hertz Floor		
Size [mm]:	w = 1000	h = 1800	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.48
125	0.76
250	1.5
500	2.4
1000	3.3
2000	3.2
4000	3.4
N₁₀ = 4.2	

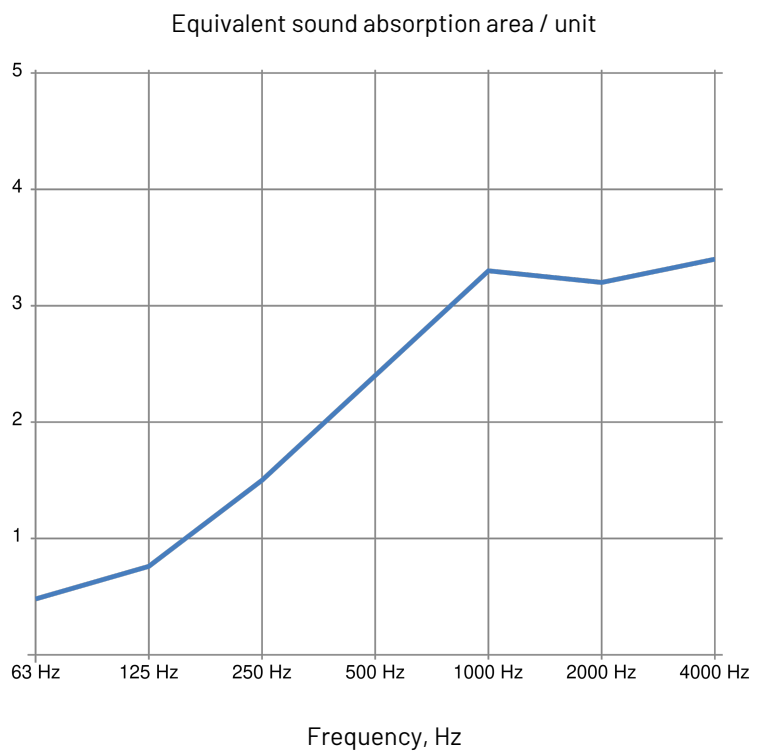

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M13	2021-10-29

