




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Decibel AB		
<b>Object:</b>	Hertz Floor		
<b>Size [mm]:</b>	w = 1200	h = 1800	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.57
125	0.86
250	1.8
500	2.9
1000	3.8
2000	3.8
4000	4.1
<b>N<sub>10</sub> = 3.4</b>	

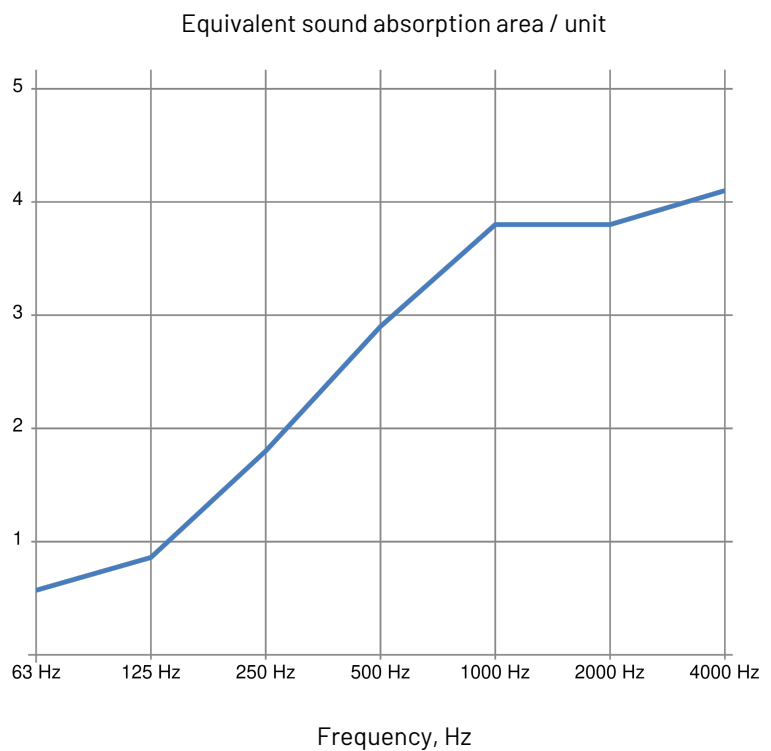

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 21-738-M14	2021-10-29

