




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Hertz Floor		
Size [mm]:	w = 800	h = 1400	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.28
125	0.44
250	0.91
500	1.6
1000	2.1
2000	2
4000	2.1
N₁₀ = 6.3	

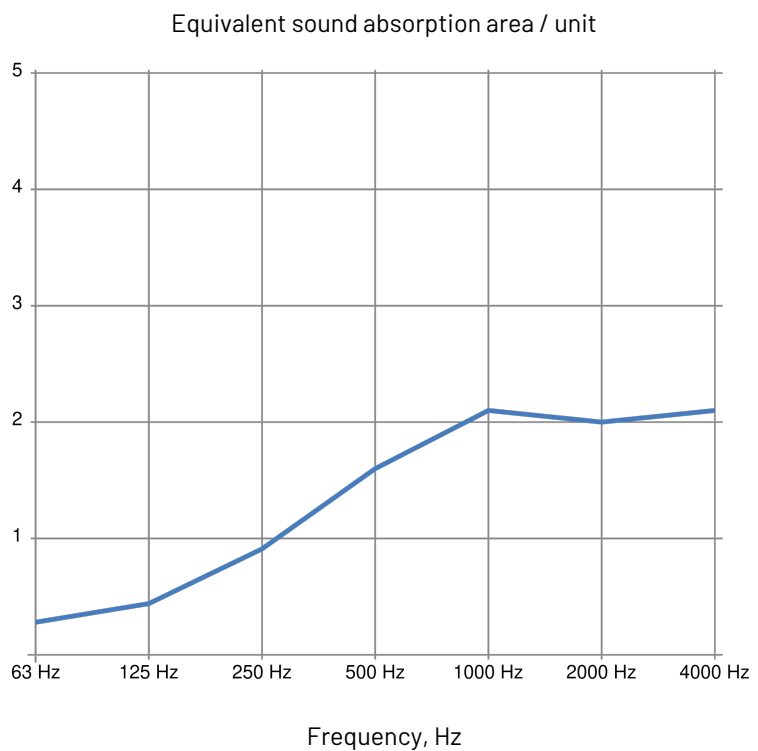

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 21-738-M10	2021-10-29
Akustikverkstan report 21-738-M12	2021-10-29

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

