




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Hertz Floor		
Size [mm]:	w = 1200	h = 1400	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.44
125	0.7
250	1.4
500	2.3
1000	3.1
2000	3.1
4000	3.2
N₁₀ = 4.3	

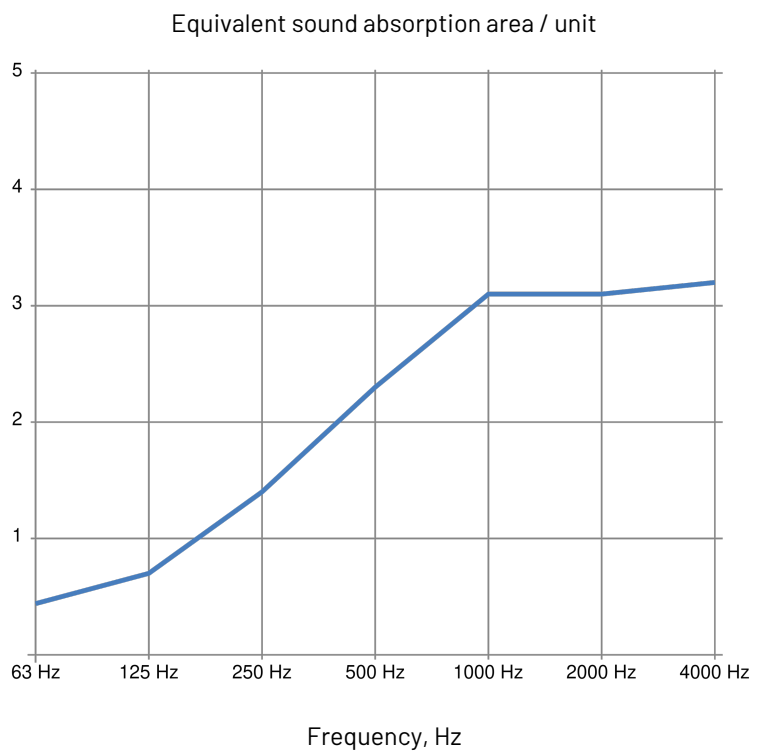

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 21-738-M11	2021-10-29
Akustikverkstan report 21-738-M13	2021-10-29

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

