


## SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client: Decibel AB
Object: Hertz Floor

**Size [mm]:** w = 800 h = 1600 d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)	
63	0.32	2
125	0.5	
250	1	
500	1.8	
1000	2.4	
2000	2.3	
4000	2.4	
	N <sub>10</sub> =	5.6

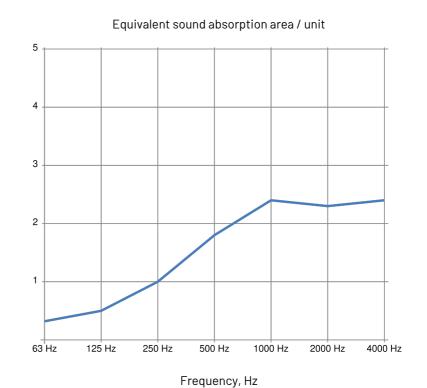

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 21-738-M12	2021-10-29
Akustikverkstan report 21-738-M11	2021-10-29

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

