


## SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client: Decibel AB
Object: Hertz Floor

**Size [mm]:** w = 1200 h = 1200 d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)	
63	0.36	
125	0.57	
250	1.3	
500	2.1	
1000	2.8	
2000	2.7	
4000	2.7	
	N <sub>10</sub> =	4.8

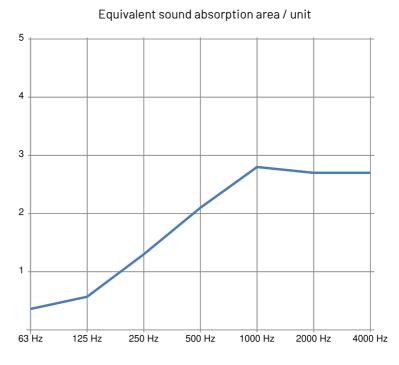

Frequency, Hz

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 21-738-M12	2021-10-29
Akustikverkstan report 21-738-M11	2021-10-29

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

