




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Hertz Floor		
Size [mm]:	w = 1200	h = 1200	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.36
125	0.57
250	1.3
500	2.1
1000	2.8
2000	2.7
4000	2.7
N₁₀ = 4.8	

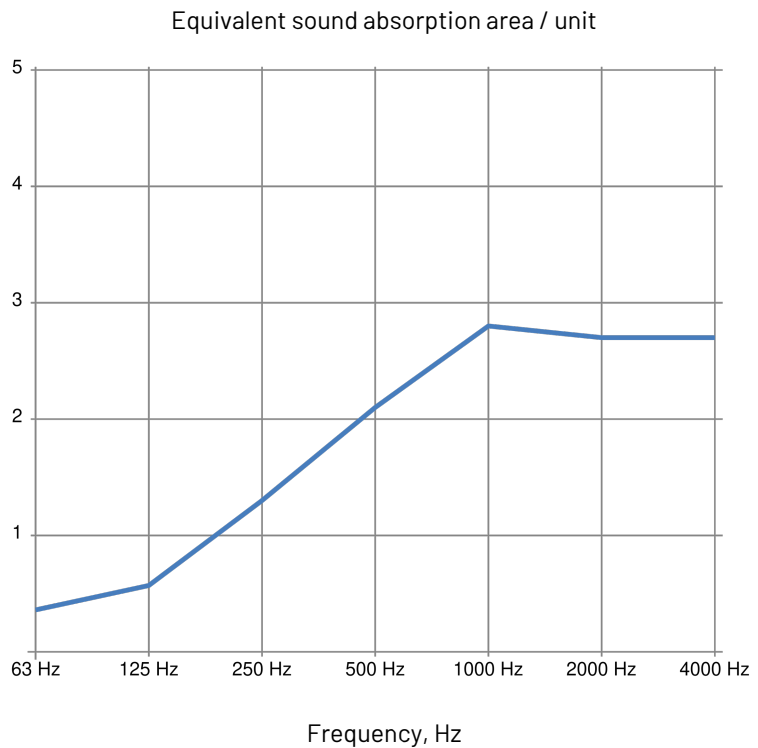

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 21-738-M12	2021-10-29
Akustikverkstan report 21-738-M11	2021-10-29

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

