




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Hertz Floor		
Size [mm]:	w = 1000	h = 1400	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.36
125	0.56
250	1.15
500	1.93
1000	2.55
2000	2.4
4000	2.62
N₁₀ = 5.2	

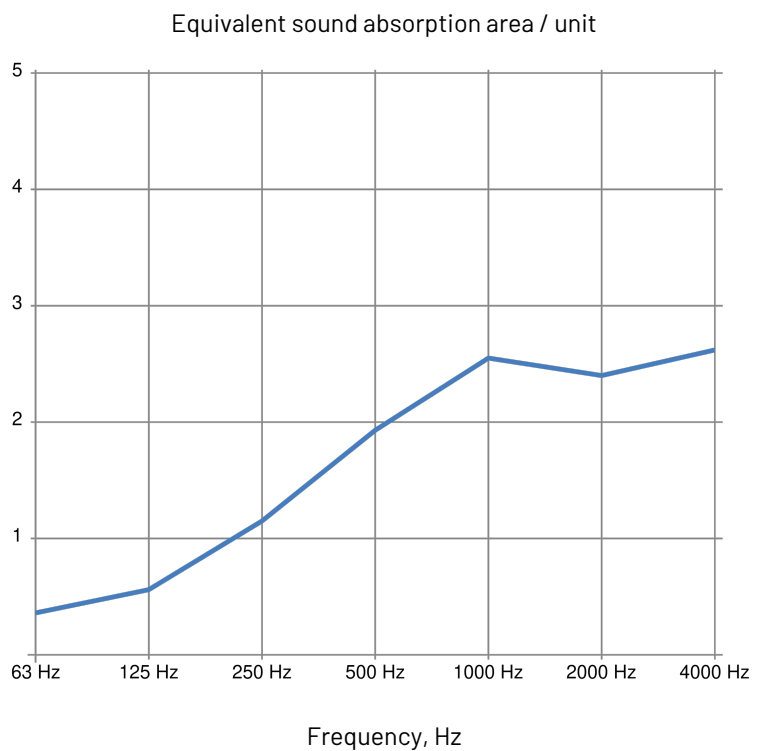

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 21-738-M12	2021-10-29
Akustikverkstan report 21-738-M13	2021-10-29

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

