




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Clamp Wall Square		
Size [mm]:	w = 600	h = 600	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.2
125	0.09
250	0.27
500	0.51
1000	0.54
2000	0.49
4000	0.443
N₁₀ = 22.6	

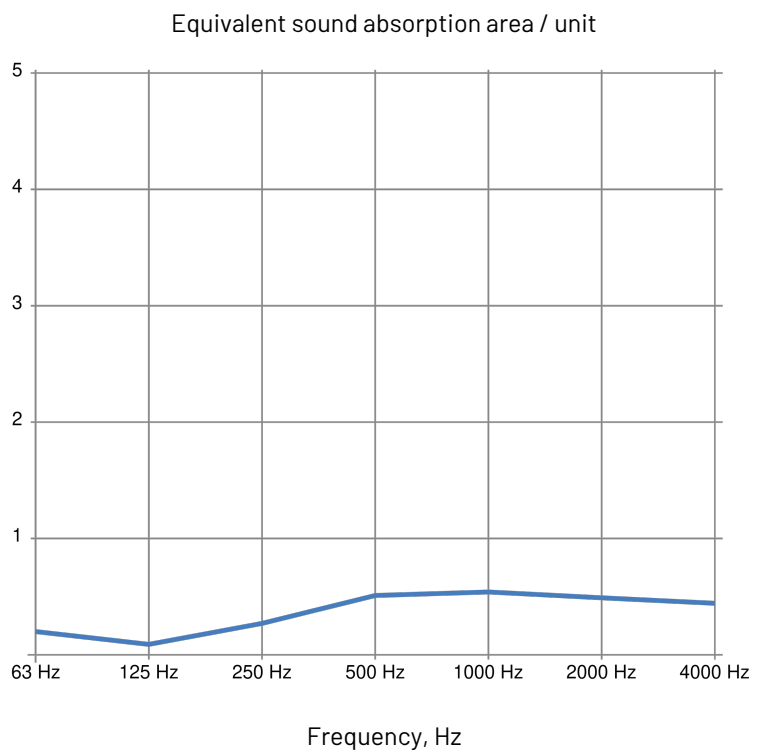

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M15	2021-10-29

