




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|-------------------|---------|--------|
| Client: | Decibel AB | | |
| Object: | Clamp Wall Square | | |
| Size [mm]: | w = 600 | h = 600 | d = 40 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|------------------------------|---|
| 63 | 0.2 |
| 125 | 0.09 |
| 250 | 0.27 |
| 500 | 0.51 |
| 1000 | 0.54 |
| 2000 | 0.49 |
| 4000 | 0.443 |
| N₁₀ = 22.6 | |

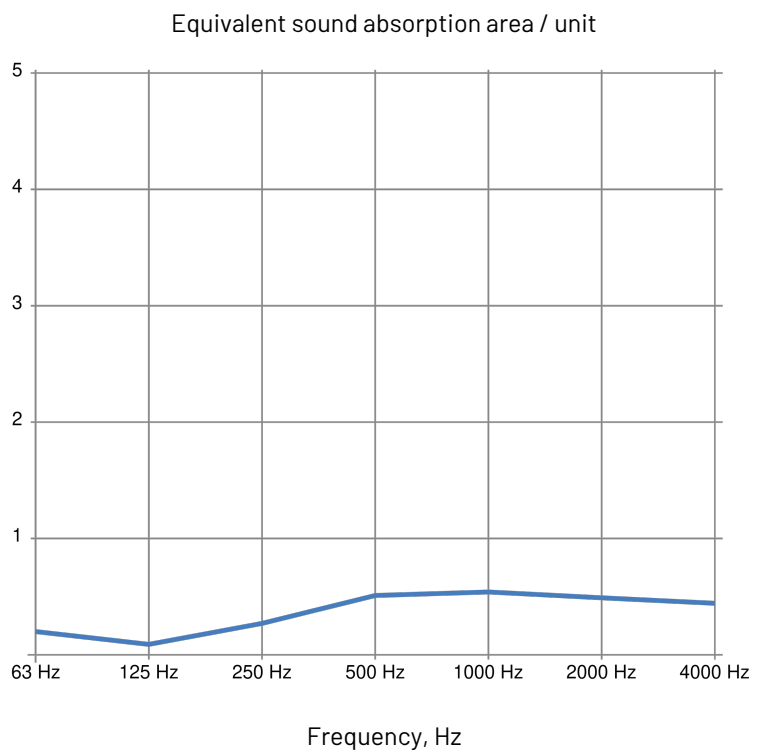

| | |
|-----------------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverkstan report 21-738-M15 | 2021-10-29 |

