




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Decibel AB		
<b>Object:</b>	Clamp Wall Square		
<b>Size [mm]:</b>	w = 800	h = 800	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.04
125	0.16
250	0.54
500	0.87
1000	0.85
2000	0.83
4000	0.73
<b>N<sub>10</sub> = 13.7</b>	

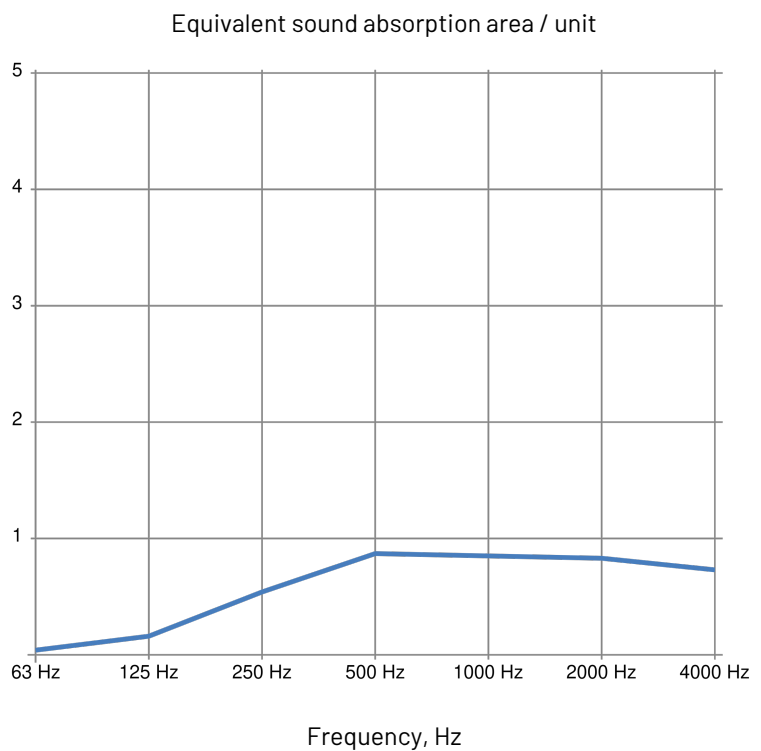

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 21-738-M16	2021-10-29

