




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Clamp Wall Round		
Size [mm]:	w = 800	h = 0	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.02
125	0.11
250	0.42
500	0.8
1000	0.82
2000	0.69
4000	0.63
N₁₀ = 15.9	

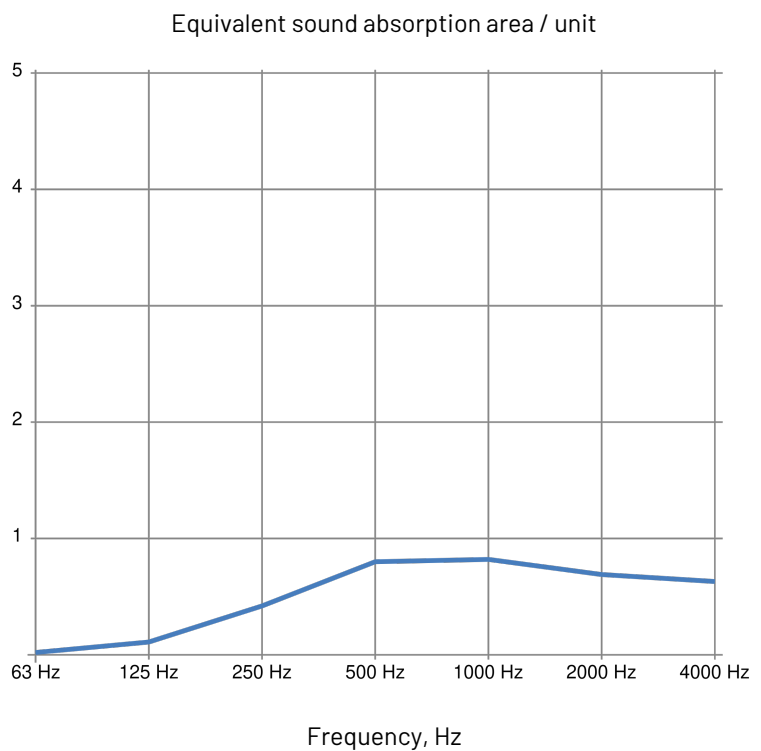

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M18	2021-10-29

