




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Decibel AB		
<b>Object:</b>	Clamp Ceiling		
<b>Size [mm]:</b>	w = 600	h = 600	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.02
125	0.09
250	0.19
500	0.45
1000	0.52
2000	0.54
4000	0.61
<b>N<sub>10</sub> = 22.2</b>	

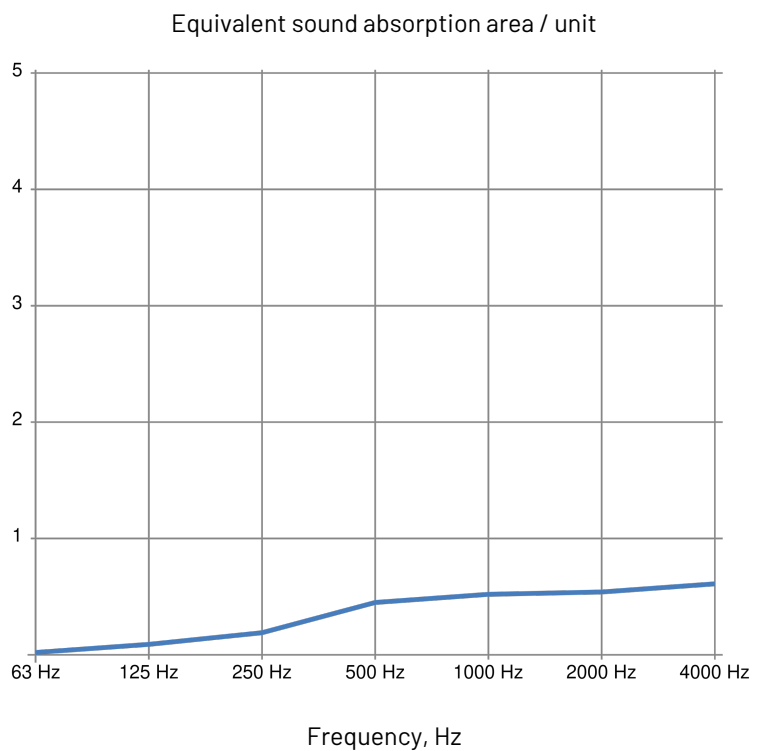

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 21-738-M19	2021-10-29

