




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Clamp Ceiling		
Size [mm]:	w = 600	h = 600	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.02
125	0.09
250	0.19
500	0.45
1000	0.52
2000	0.54
4000	0.61
N₁₀ = 22.2	

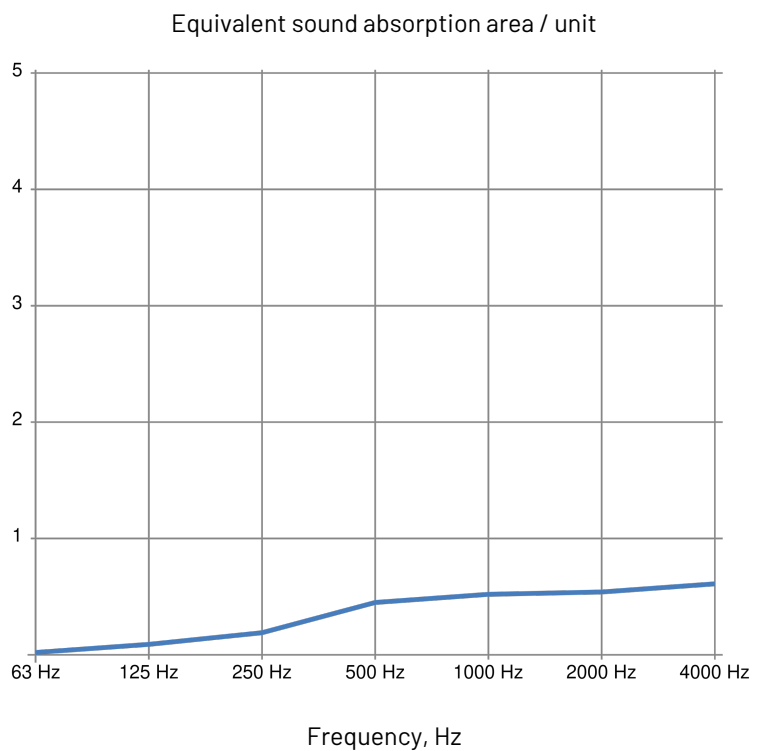

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M19	2021-10-29

