




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Clamp Floor		
Size [mm]:	w = 1200	h = 1700	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.49
125	0.78
250	1.6
500	2.7
1000	3.5
2000	3.4
4000	3.6
N₁₀ = 3.7	

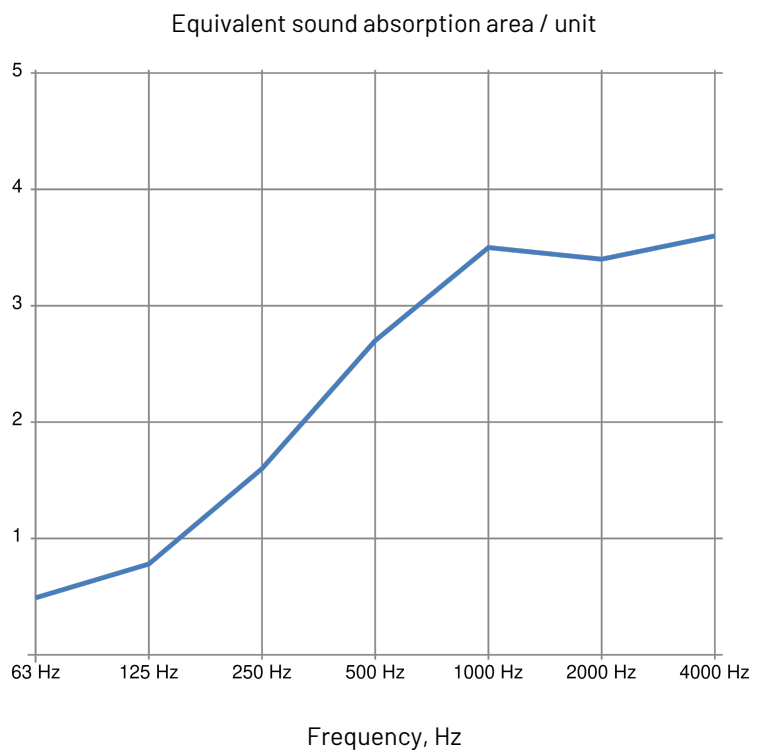

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M21	2021-10-29

