




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|---|---------|-------|
| Client: | Götessons/ Gotessons, Akustikmiljö / Am Acoustics | | |
| Object: | Cobogo (3 groups of 12 units) | | |
| Size [mm]: | w = 372 | h = 372 | d = 5 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|------------------------------|---|
| 63 | 0 |
| 125 | 0.03 |
| 250 | 0.07 |
| 500 | 0.19 |
| 1000 | 0.43 |
| 2000 | 0.67 |
| 4000 | 0.89 |
| N₁₀ = 52.6 | |

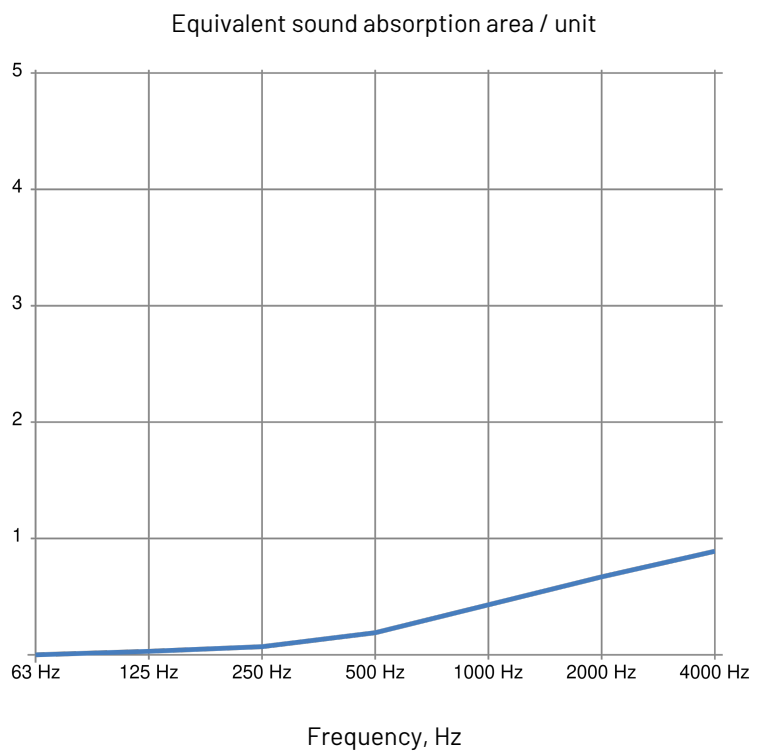

| | |
|----------------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverkstan report 22-702-M3 | 2022-02-28 |

