




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Boom Interior		
Object:	Xrozz Absorption Reinforced		
Size [mm]:	w = 600	h = 1000	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.18
125	0.27
250	0.42
500	0.52
1000	0.6
2000	0.74
4000	0.94
N₁₀ = 19.2	

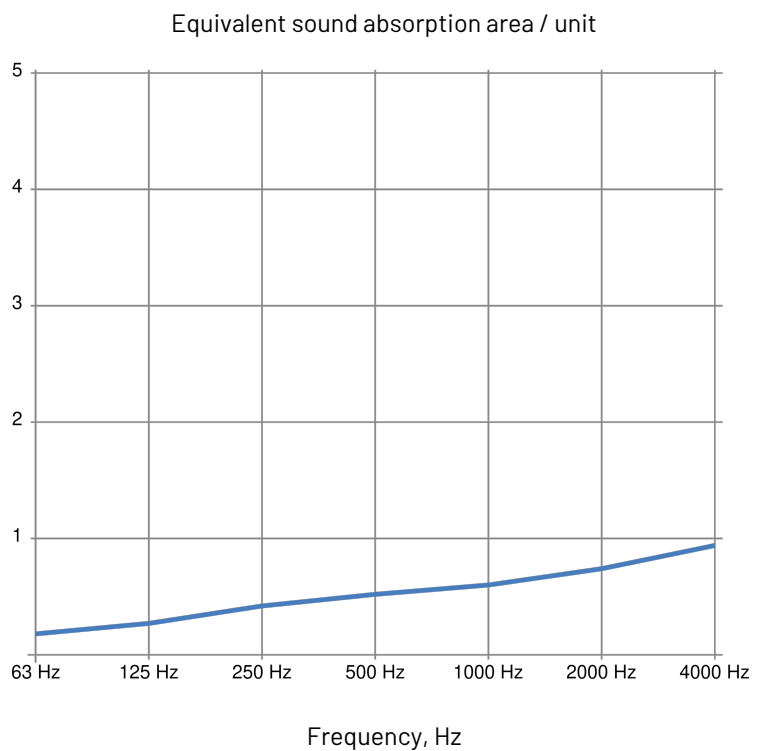

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M14a	2018-08-23
Akustikverkstan report 18-701-M15a	2018-08-23

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

