




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Absorption Reinforced		
<b>Size [mm]:</b>	w = 800	h = 1400	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.36
125	0.48
250	0.76
500	0.95
1000	1.2
2000	1.4
4000	1.7
<b>N<sub>10</sub> = 10.5</b>	

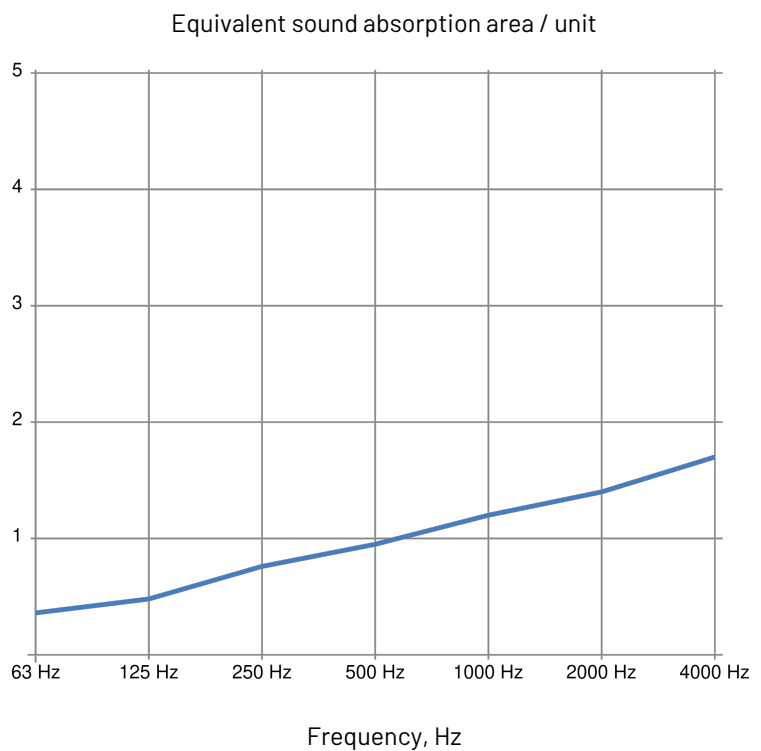

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 18-701-M17a	2018-08-23

