


# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Absorption Reinforced		
<b>Size [mm]:</b>	w = 800	h = 1600	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.4
125	0.6
250	0.9
500	1.2
1000	1.3
2000	1.7
4000	1.9
<b>N<sub>10</sub> = 8.3</b>	

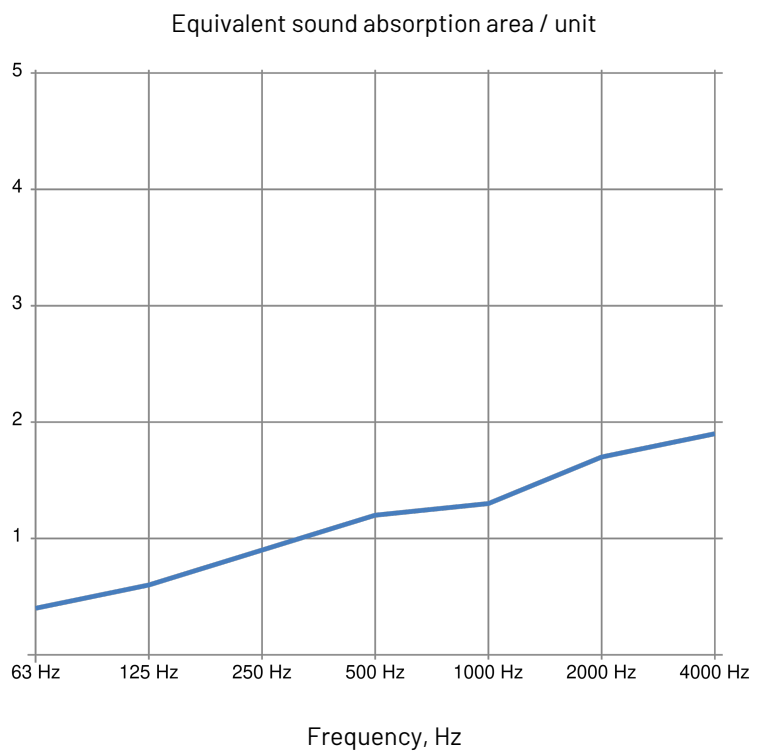

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 18-701-M18	2018-08-23

