




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Absorption Reinforced		
<b>Size [mm]:</b>	w = 800	h = 2000	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.5
125	0.6
250	1
500	1.3
1000	1.5
2000	1.8
4000	2.2
<b>N<sub>10</sub> = 7.7</b>	

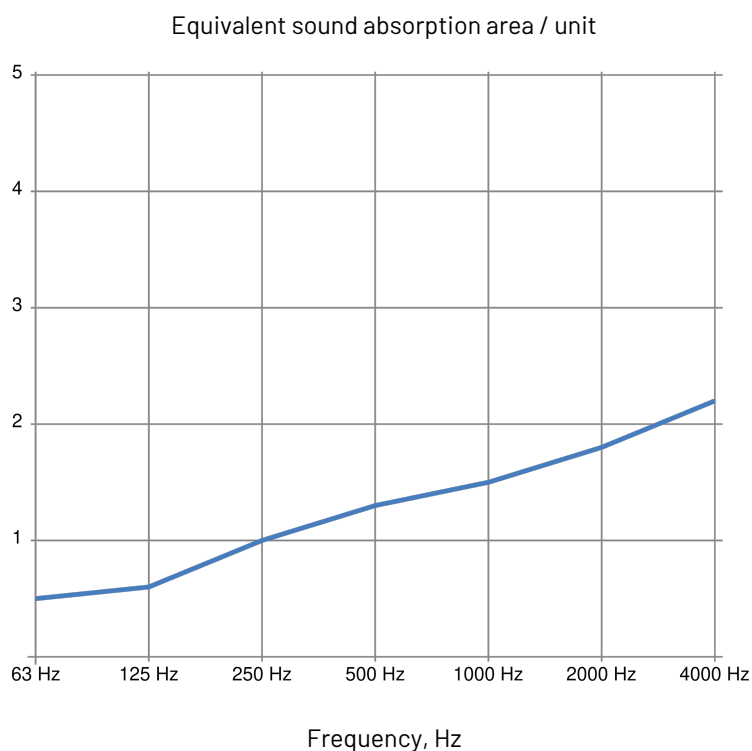

## ORIGINAL TEST REPORTS

Akustikverkstan report 18-701-M19  
Akustikverkstan report 18-701-M11

## DATE OF REPORT

2018-08-23  
2018-08-23

*The presented results are interpolated using the method described in ISO 20189 from the original test reports.*

