




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|------------------|----------|--------|
| Client: | Boom Interior | | |
| Object: | Xrozz Integrated | | |
| Size [mm]: | w = 600 | h = 1200 | d = 40 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|------------------------------|---|
| 63 | 0.22 |
| 125 | 0.34 |
| 250 | 0.5 |
| 500 | 0.61 |
| 1000 | 0.71 |
| 2000 | 0.89 |
| 4000 | 1.1 |
| N₁₀ = 16.4 | |

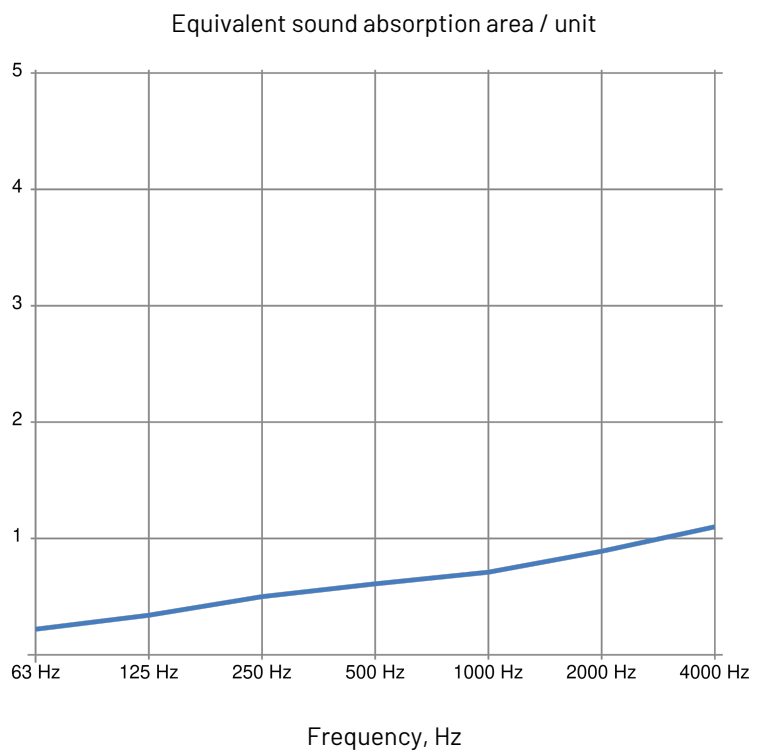

| | |
|-----------------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverkstan report 18-701-M2a | 2018-08-23 |

