




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

|                   |                  |          |        |
|-------------------|------------------|----------|--------|
| <b>Client:</b>    | Boom Interior    |          |        |
| <b>Object:</b>    | Xrozz Integrated |          |        |
| <b>Size [mm]:</b> | w = 800          | h = 2000 | d = 40 |

| Octave band (Hz)            | Equivalent sound absorption area / unit (m <sup>2</sup> Sabine) |
|-----------------------------|---|
| 63                          | 0.54  |
| 125                         | 0.62  |
| 250                         | 1.03  |
| 500                         | 1.38  |
| 1000                        | 1.61  |
| 2000                        | 1.97  |
| 4000                        | 2.34  |
| <b>N<sub>10</sub> = 7.2</b> |   |

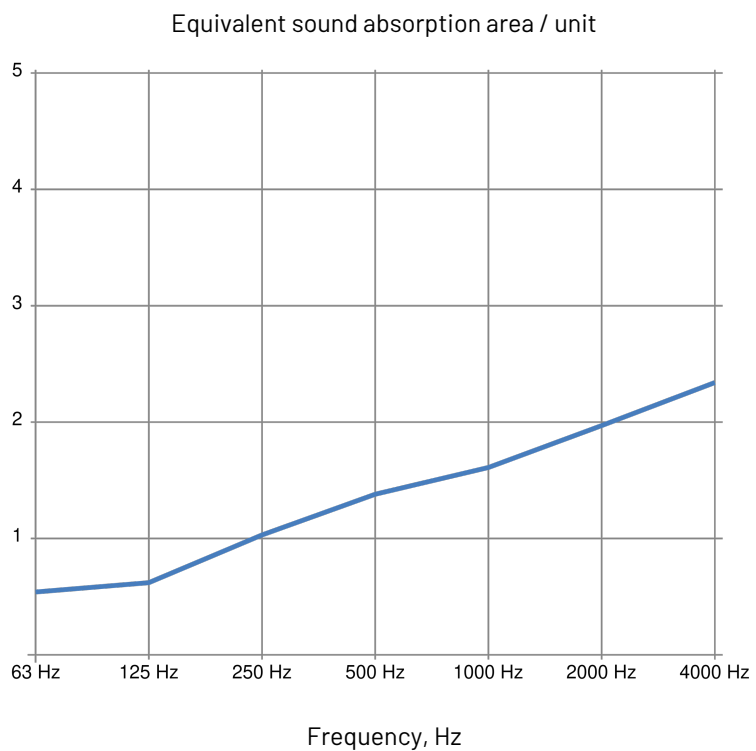

| ORIGINAL TEST REPORTS             | DATE OF REPORT |
|-----------------------------------|----------------|
| Akustikverkstan report 18-701-M6  | 2018-08-23     |
| Akustikverkstan report 18-701-M11 | 2018-08-23     |

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

