




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|------------------|----------|--------|
| Client: | Boom Interior | | |
| Object: | Xrozz Integrated | | |
| Size [mm]: | w = 800 | h = 2000 | d = 40 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 0.54 |
| 125 | 0.62 |
| 250 | 1.03 |
| 500 | 1.38 |
| 1000 | 1.61 |
| 2000 | 1.97 |
| 4000 | 2.34 |
| N₁₀ = 7.2 | |

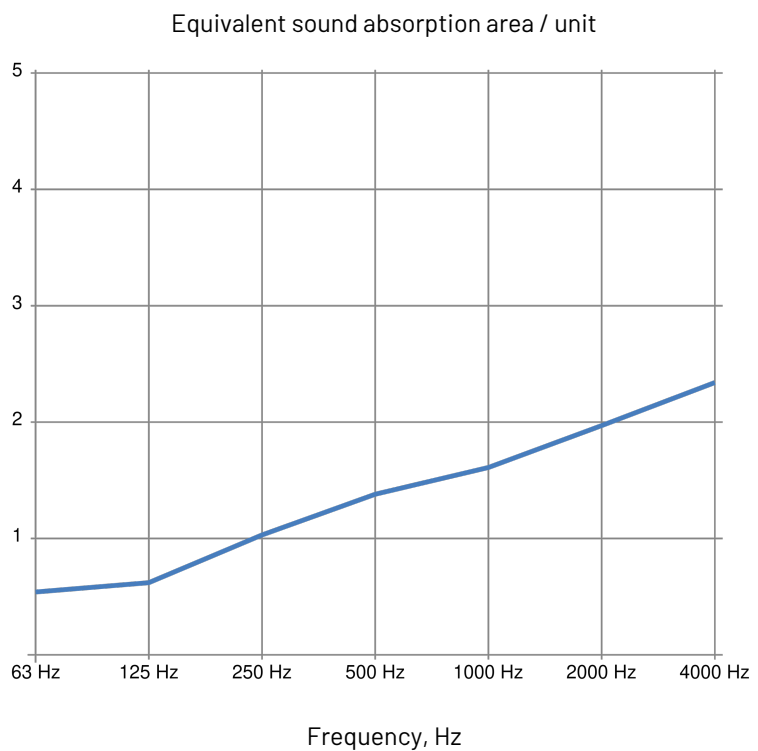

| ORIGINAL TEST REPORTS | DATE OF REPORT |
|-----------------------------------|----------------|
| Akustikverkstan report 18-701-M6 | 2018-08-23 |
| Akustikverkstan report 18-701-M11 | 2018-08-23 |

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

