




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Absorption Recycled		
<b>Size [mm]:</b>	w = 600	h = 1000	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.18
125	0.27
250	0.42
500	0.52
1000	0.6
2000	0.74
4000	0.94
<b>N<sub>10</sub> = 19.2</b>	

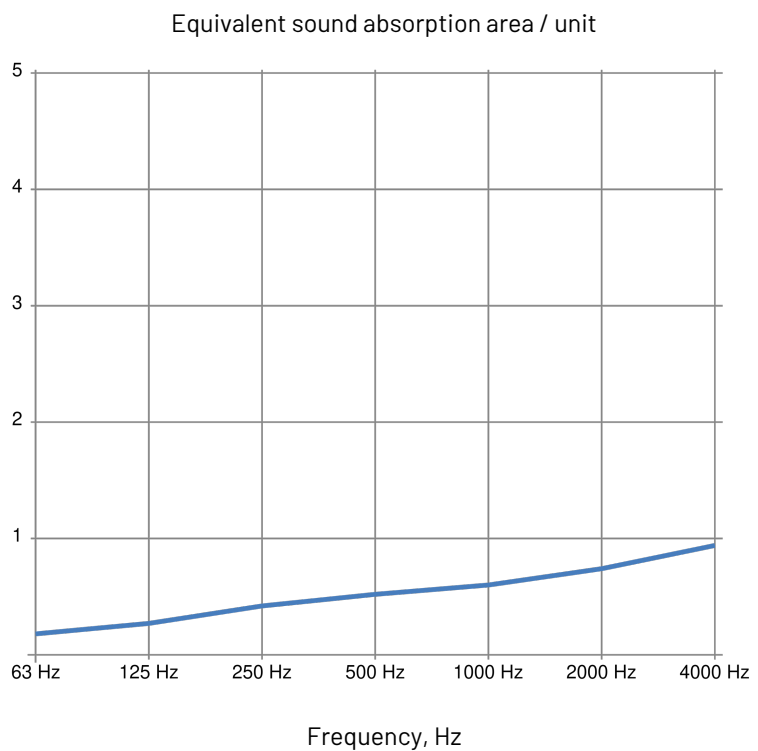

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M1a	2018-08-23
Akustikverkstan report 18-701-M2a	2018-08-23

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

