




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Absorption Recycled		
<b>Size [mm]:</b>	w = 600	h = 1200	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.22
125	0.34
250	0.5
500	0.61
1000	0.71
2000	0.89
4000	1.1
<b>N<sub>10</sub> = 16.4</b>	

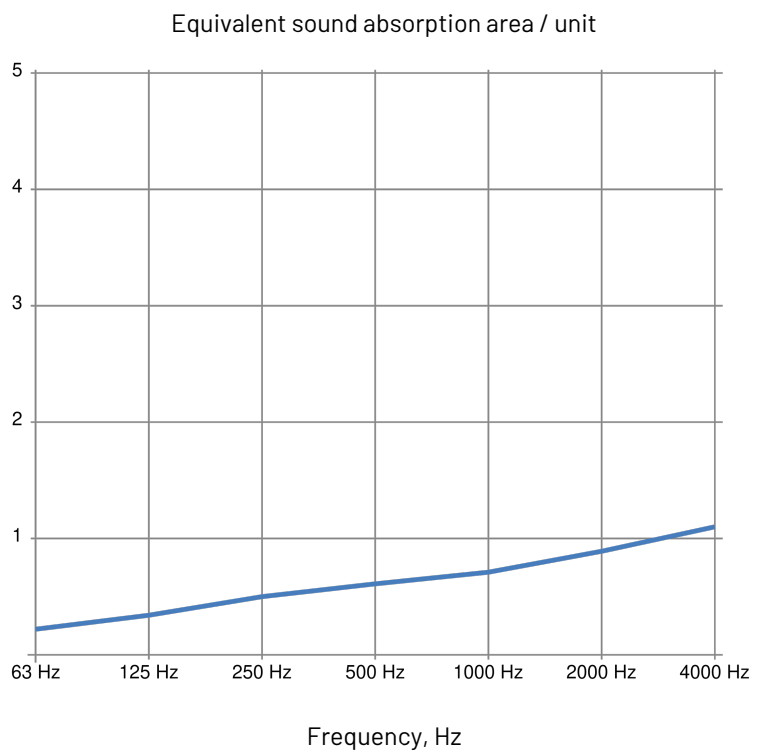

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 18-701-M2a	2018-08-23

