




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|---------------------------|----------|--------|
| Client: | Boom Interior | | |
| Object: | Xrozz Absorption Recycled | | |
| Size [mm]: | w = 800 | h = 1000 | d = 40 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|------------------------------|---|
| 63 | 0.25 |
| 125 | 0.35 |
| 250 | 0.56 |
| 500 | 0.7 |
| 1000 | 0.81 |
| 2000 | 1 |
| 4000 | 1.24 |
| N₁₀ = 14.3 | |

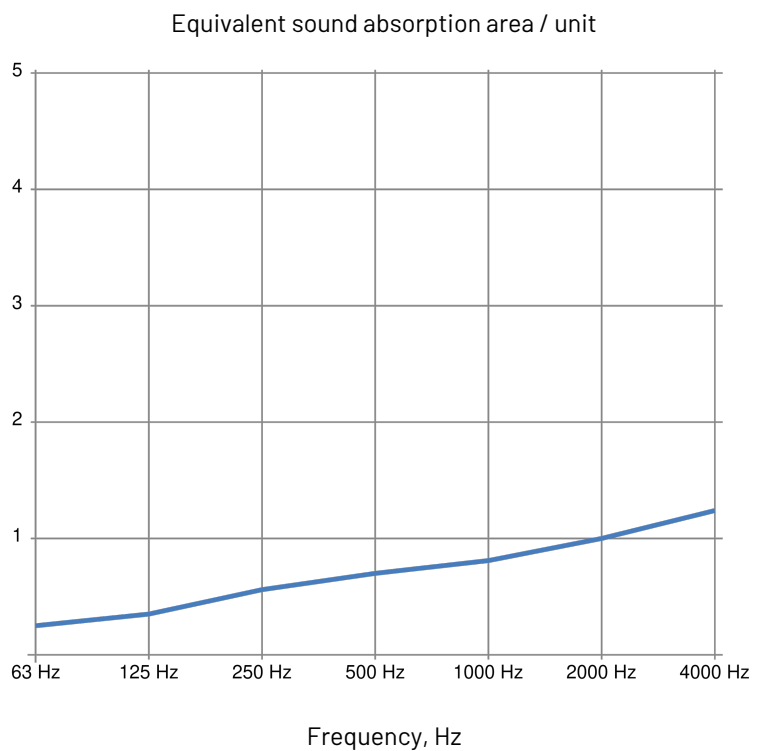

| ORIGINAL TEST REPORTS | DATE OF REPORT |
|----------------------------------|----------------|
| Akustikverkstan report 20-240M2 | 2020-06-24 |
| Akustikverkstan report 18-701-M3 | 2018-08-23 |

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

