




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|---------------------------|----------|--------|
| Client: | Boom Interior | | |
| Object: | Xrozz Absorption Recycled | | |
| Size [mm]: | w = 800 | h = 1600 | d = 40 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 0.4 |
| 125 | 0.6 |
| 250 | 0.9 |
| 500 | 1.2 |
| 1000 | 1.3 |
| 2000 | 1.7 |
| 4000 | 1.9 |
| N₁₀ = 8.3 | |

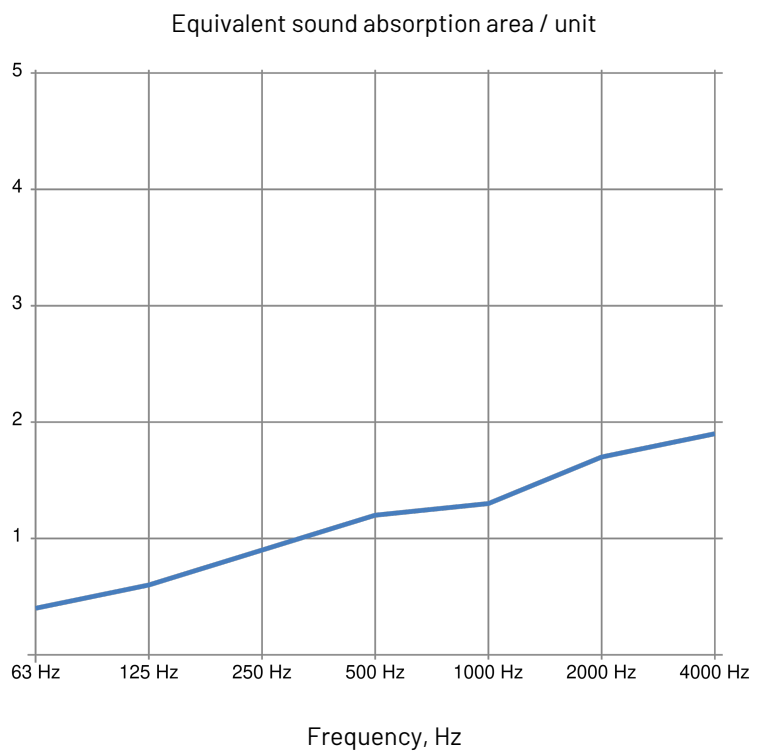

| | |
|----------------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverkstan report 18-701-M5 | 2018-08-23 |

