




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|-----------------------|----------|--------|
| Client: | Boom Interior | | |
| Object: | Xrozz Absorption Plus | | |
| Size [mm]: | w = 600 | h = 1400 | d = 50 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|----------------------|---|
| 63 | 0.18 |
| 125 | 0.29 |
| 250 | 0.64 |
| 500 | 1 |
| 1000 | 1.4 |
| 2000 | 1.5 |
| 4000 | 1.6 |
| N ₁₀ = 10 | |

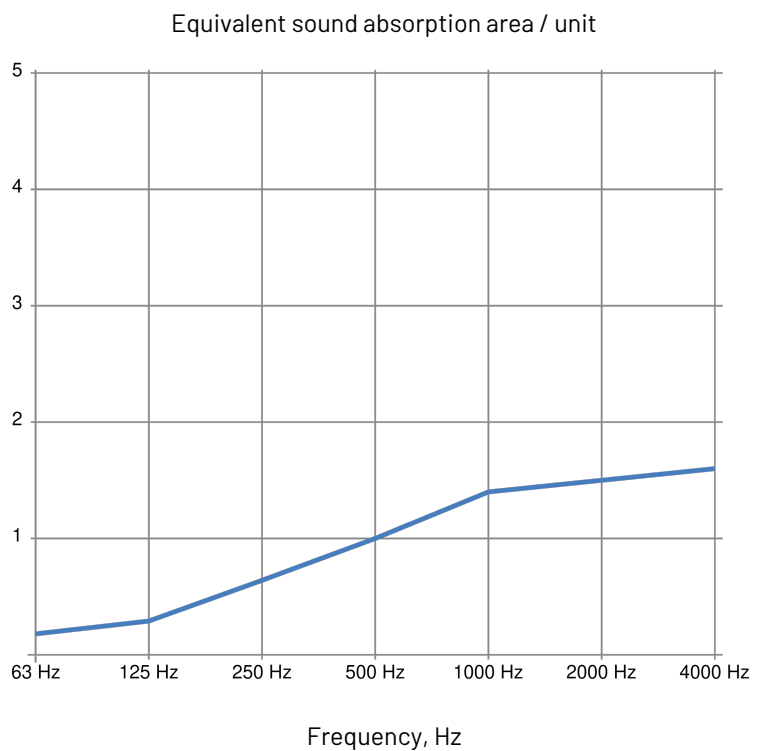

| | |
|----------------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverkstan report 21-720-M4 | 2021-07-12 |

