




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Absorption Plus		
<b>Size [mm]:</b>	w = 600	h = 1800	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.27
125	0.4
250	0.81
500	1.3
1000	1.8
2000	1.9
4000	2.1
<b>N<sub>10</sub> = 7.7</b>	

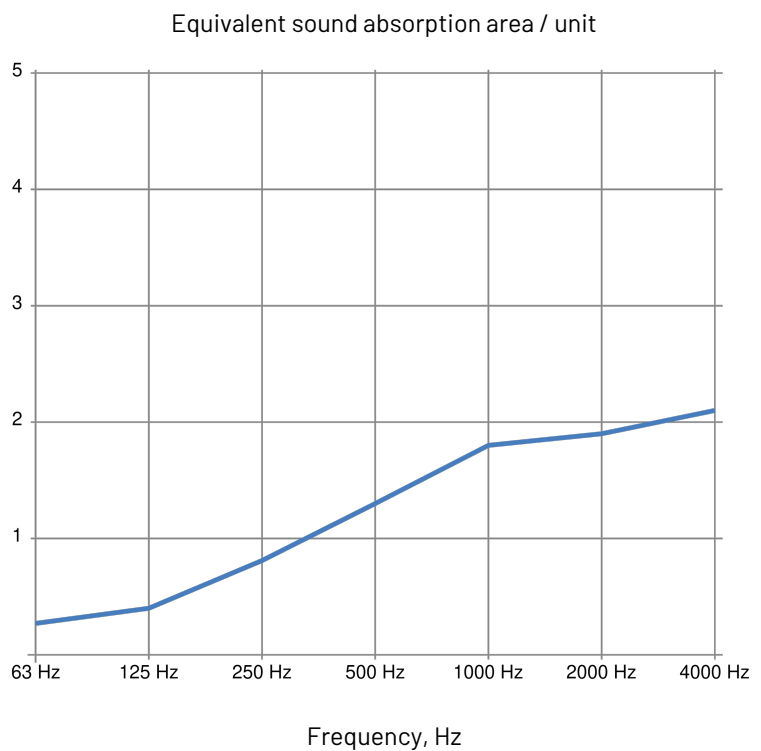

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 21-720-M6	2021-07-12

