




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Boom Interior		
Object:	Xrozz Floorscreen		
Size [mm]:	w = 1200	h = 1200	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.45
125	0.58
250	0.99
500	0.96
1000	1.48
2000	1.8
4000	2.2
N ₁₀ = 10.4	

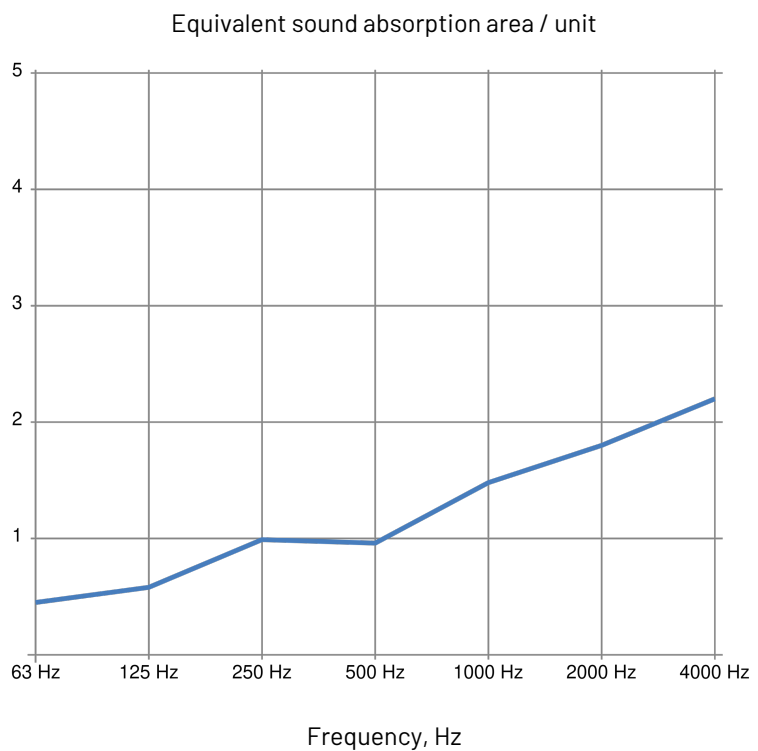

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M10	2018-08-23
Akustikverkstan report 18-701-M11	2018-08-23

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

