




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Boom Interior		
Object:	Xrozz Floorscreen		
Size [mm]:	w = 1200	h = 1800	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.7
125	0.81
250	1.3
500	1.78
1000	2.2
2000	2.62
4000	3.04
N₁₀ = 5.6	

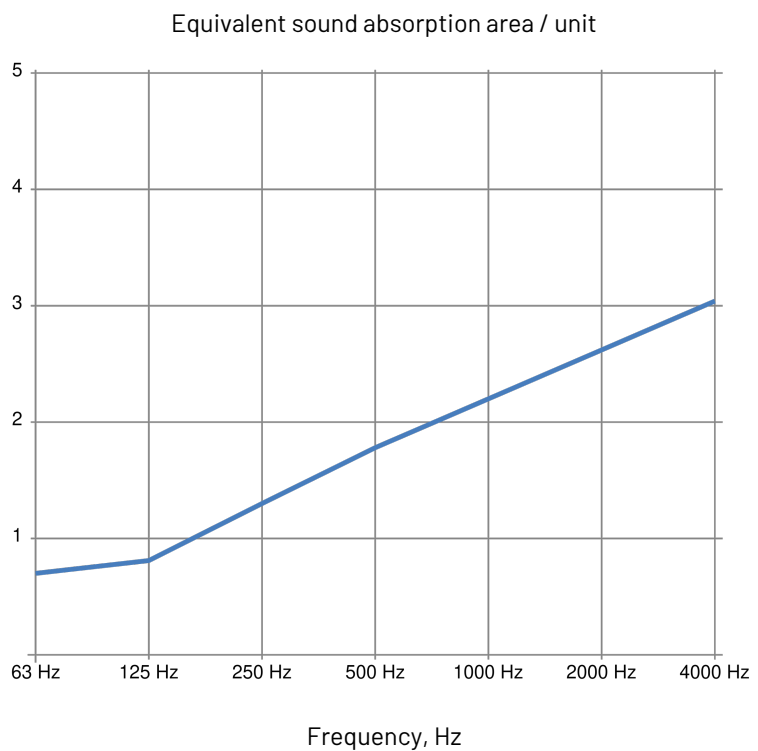

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M12	2018-08-23
Akustikverkstan report 18-701-M13	2018-08-23

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

