




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Floorscreen		
<b>Size [mm]:</b>	w = 1400	h = 1600	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.72
125	0.84
250	1.34
500	1.84
1000	2.27
2000	2.71
4000	3.14
<b>N<sub>10</sub> = 5.4</b>	

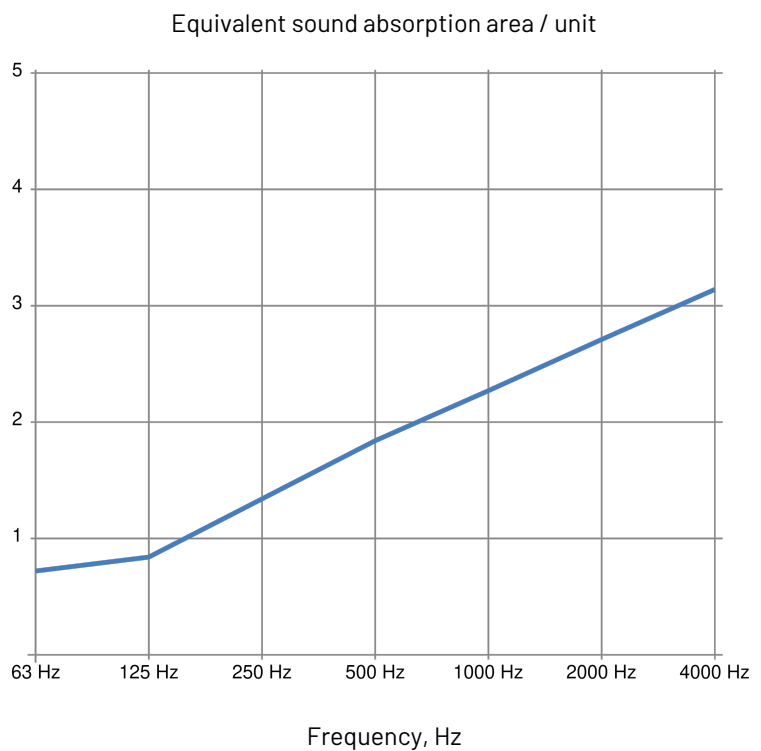

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M12	2018-08-23
Akustikverkstan report 18-701-M13	2018-08-23

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

