




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Floorscreen		
<b>Size [mm]:</b>	w = 1600	h = 1200	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.62
125	0.7
250	1.19
500	1.59
1000	1.96
2000	2.33
4000	2.73
<b>N<sub>10</sub> = 6.3</b>	

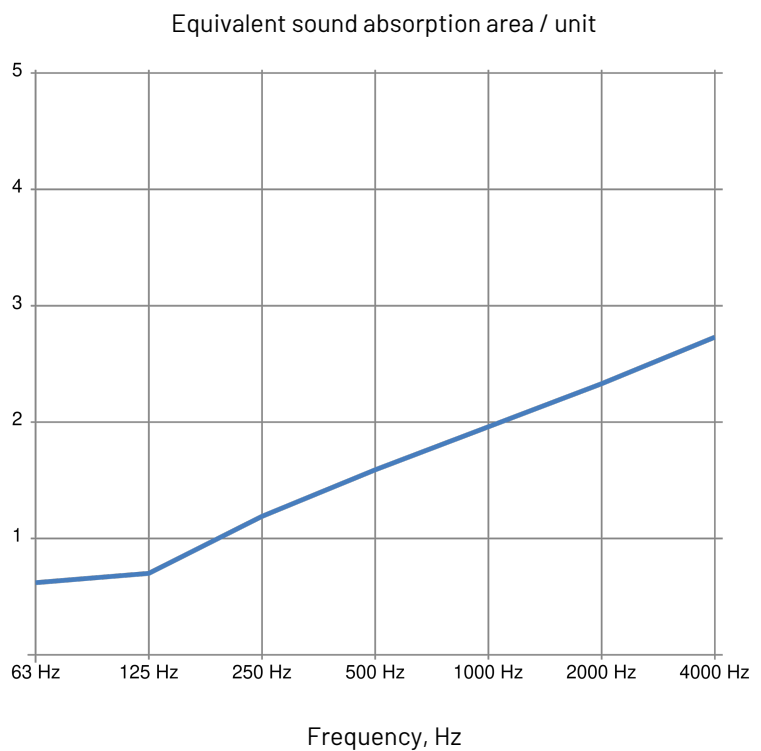

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M11	2018-08-23
Akustikverkstan report 18-701-M12	2018-08-23

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

