




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|-------------------|----------|--------|
| Client: | Boom Interior | | |
| Object: | Xrozz Floorscreen | | |
| Size [mm]: | w = 1600 | h = 1400 | d = 40 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 0.72 |
| 125 | 0.84 |
| 250 | 1.34 |
| 500 | 1.84 |
| 1000 | 2.27 |
| 2000 | 2.71 |
| 4000 | 3.14 |
| N₁₀ = 5.4 | |

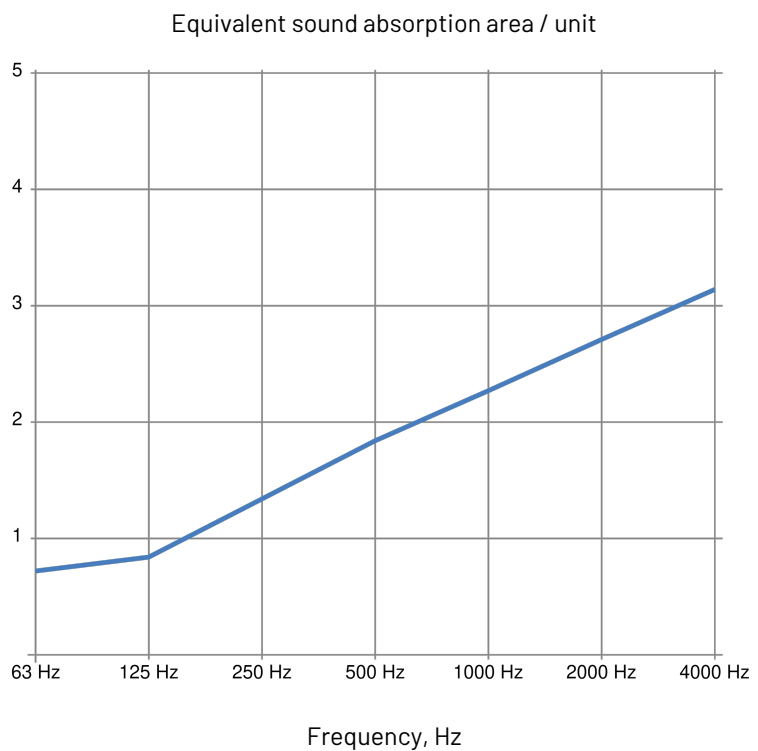

| ORIGINAL TEST REPORTS | DATE OF REPORT |
|-----------------------------------|----------------|
| Akustikverkstan report 18-701-M12 | 2018-08-23 |
| Akustikverkstan report 18-701-M13 | 2018-08-23 |

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

