




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Absorption Ovan Bord		
<b>Size [mm]:</b>	w = 450	h = 1200	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.15
125	0.23
250	0.38
500	0.47
1000	0.55
2000	0.67
4000	0.85
<b>N<sub>10</sub> = 21.3</b>	

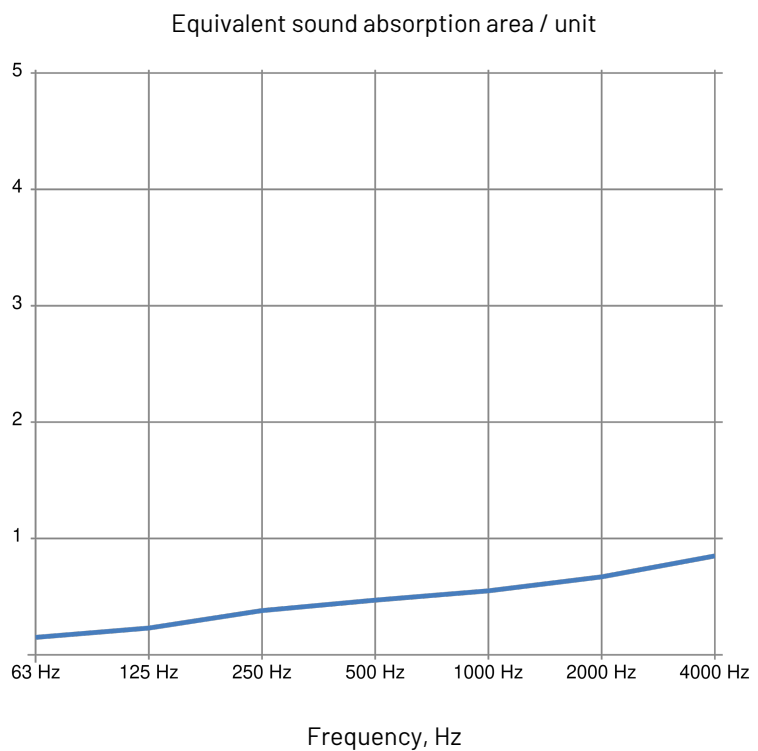

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M1a	2018-08-23
Akustikverkstan report 20-240-M1	2020-06-24

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

